




CITY OF CITRUS HEIGHTS GENERAL SERVICES DEPARTMENT

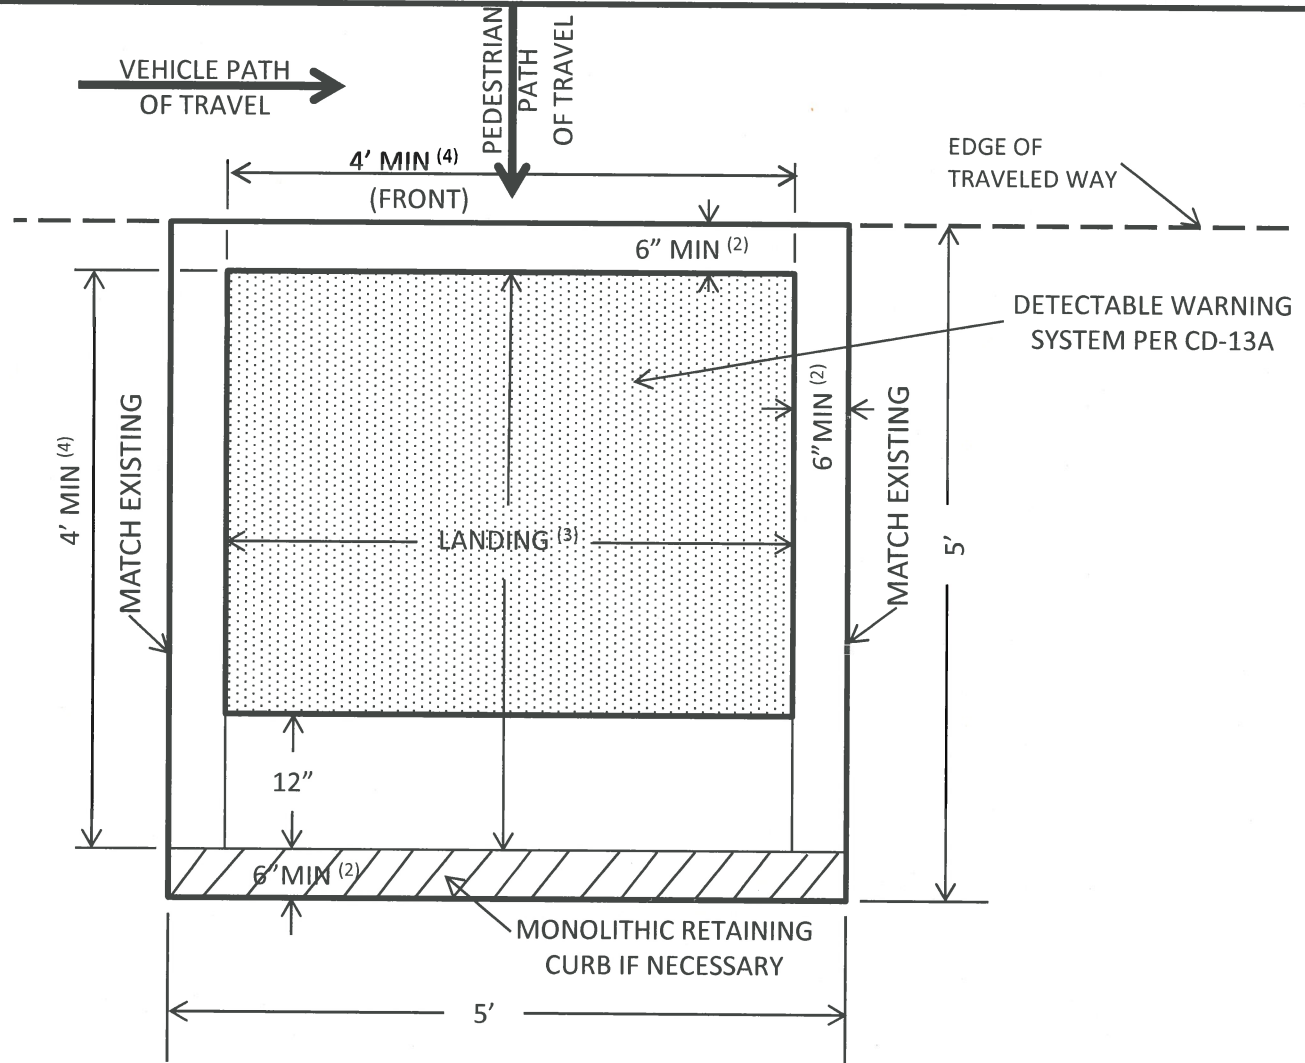

NOTES:

1. BLENDED TRANSITION SHALL BE 4" PCC OVER 4" CLASS II AB
2. CONSTRUCT PERIMETER BAND (MINIMUM 6") WIDE TO MATCH EXISTING SURFACE
3. SLOPE OF LANDING PAD SHALL NOT EXCEED 1.5% IN ANY DIRECTION
4. BLENDED TRANSITION CLEAR WIDTH AND DEPTH SHALL BE 4' MINIMUM

APPROVED BY:

Stuart Hodgkins
STUART HODGKINS, ACTING CITY ENGINEER

BLENDED TRANSITION DETAIL

APPROVAL DATE: 9/2/14

SCALE: NONE

DRAWN BY: Ian Bello

CD-24